


**PLAN VIEW**

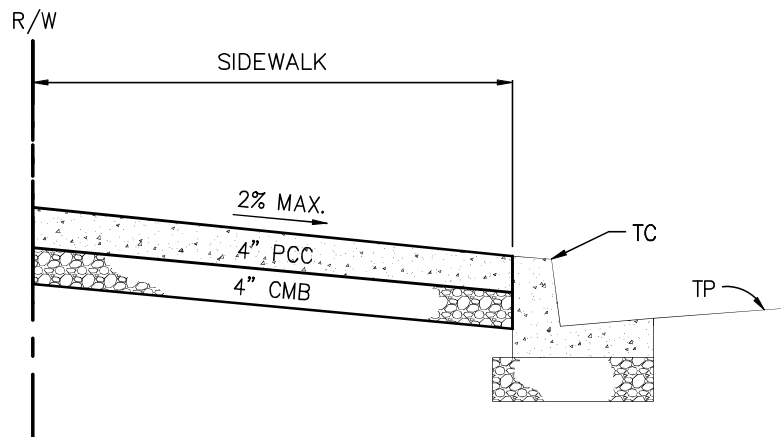

**SECTION A-A**

NOTES:

1. ALL CONSTRUCTION SHALL BE IN CONFORMANCE WITH THE "SPPWC" LATEST EDITION.
2. PCC SHALL BE 520-C-2500 PER "SPPWC" LATEST EDITION.
3. EXISTING CONCRETE SHALL BE REMOVED TO THE NEAREST SCOREMARK.
4. BASE SHALL BE CMB AND TO 95% RELATIVE COMPACTION. EX. SIDEWALK REPLACEMENT REQUIRES 90% MIN. COMPACTION ON EX. BASE MATERIAL.
5. TREE WELLS SHALL BE CONSTRUCTED PER STANDARD ST-11 AT 40' INTERVALS LESS THAN 4'x4' TREE WELL TO ACCOMMODATE ADA REQUIREMENTS SHALL BE APPROVED BY THE CITY ENGINEER.
6. FINE HAIR BROOM FINISH ON SIDEWALK.

DWG NTS

CITY OF GARDENA  
DEPARTMENT OF PUBLIC WORKS

APP. BY:

*Allan Rigg*

9/16/2024

CITY ENGINEER

DATE

TITLE:

COMMERCIAL SIDEWALK

DESIGNED BY

KK

09/24

DRAWN BY

KK

09/24

CHECKED BY

KK

09/24

DWG.  
NO.

ST-7